

## Simplified risk assessment on fire hazard of LPG filling station

Kyoshik Park<sup>†</sup>

Chemical Engineering Department, Myongji University, Myongji-ro 116, Yongin-si, Gyeonggi-do 17058, Korea  
(Received 7 July 2016 • accepted 20 November 2016)

**Abstract**—Layer of protection analysis (LOPA) was conducted on the fire hazard of LPG filling stations. Scenarios were developed for jet fire, pool fire, and boiling liquid expanding vapor explosion (BLEVE). For each scenario, independent protection layers (IPLs) of the LPG station were identified and their frequencies were estimated. Risk matrix to determine the risk category was constructed, combining consequence and frequency of each scenario. Three additional IPLs were considered, such as a firewall between the tank lorry parking area and LPG facility, water deluge system for tank lorry, and excess flow shutdown valve for liquid pipeline to stop unexpected excess flow. Adding such IPLs could markedly reduce the risk to the facility.

Keywords: Layer of Protection Analysis (LOPA), LPG Filling Station, Fire Hazard, IPL, Risk

### INTRODUCTION

As a city expands with development, the residential area has more chance to be next to hazardous sites, such as LPG filling stations, which once were remote from residential areas to comply with regulations. It's not simple for a regulatory agency to force the station to move away from residential or commercial area to satisfy safety criteria. Instead, they recommend reasonable measures to reduce the corresponding risk by adding appropriate safeguards. The Korean government introduced Off-Site Risk Assessment (ORA) and Korean Risk Management Plan (K-RMP) in 2015 to assess the risk of hazardous sites and suggest measures to reduce it systematically [1,2]. Layer of protection analysis (LOPA) is a very simple and effective way to find such safeguards applicable to the analysis of LPG station.

Since the early 1960s when liquefied petroleum gas (LPG) was first introduced in Korea, the consumption of LPG has kept increasing, and LPG plays an important role as clean, convenient, and environmentally friendly fuel for not only automobiles, but also industrial and residential applications. Although major numbers of LPG stations are far remote from residential or commercial area, many of the stations are still located near populated areas and should be handled with care, as shown in Table 1 [3]. LPG station incidents in Korea are managed by the Korean government and show that major causes of incidents are human errors such as improper coupling of hoses from tank lorries to underground storage tanks, starting vehicles during dispensing, and collisions of vehicles with

dispensers. To reduce the risks caused by such incidents, a facile and systematic approach is needed to provide countermeasures.

Evaluating hazard and assessing risk of hazardous facilities is one of the most important activities to keep the site safe. Several studies have been conducted, such as on how to review the current methodologies for plant layout optimization and to resolve facility siting issues [4], on how to reduce accidental exposure to various reagents that are toxic, explosive, or carcinogenic [5], or on how to apply advanced layers of protection analysis (LOPA) method to assess the risk of a chemical process [6]. The layer of protection analysis (LOPA) was introduced in the 1990s for semi-quantitative risk assessment, having advantages of both qualitative and quantitative methods of risk evaluation as has been described in the CCPS textbook [7]. LOPA is known to be a powerful analytical tool for assessing the adequacy of protection layers used to mitigate process risk. The LPG station is a relatively simple structure compared with other hazardous facilities, such as chemical processes, and is good for applying LOPA instead of quantitative method to save time and resources. In this work, LOPA was conducted on fire hazards of LPG station. Although unconfined vapor cloud explosion (UVCE) is another significant consequence, it varies widely with environmental factors such as climate and surface roughness and is excluded in this study.

### DESCRIPTION OF THE LPG FILLING STATION

Typical LPG filling station facilities in Korea are described in

**Table 1. Location of LPG filling station as of 2014 in Korea**

Area	Residential	Commercial	Industrial	Suburban	Rural	Total
Number of stations	149	62	213	1,268	343	2,035

<sup>†</sup>To whom correspondence should be addressed.

E-mail: hwayi21@empal.com

Copyright by The Korean Institute of Chemical Engineers.

**Table 2. Typical equipment of an LPG filling station**

Facility	Equipment	Capacity (unit)
Storage	Butane tank	15 ton (1EA)
Loading / Unloading	Liquid pump	5.5 kW
	Gas compressor	5.5 kW (7.5 HP)
	Dispenser	3EA
	Loading arm	50A, 25A
Safety	Emergency power supply	26 kW
	Gas detector	9EA
	Emergency shutdown valve	50A 1EA

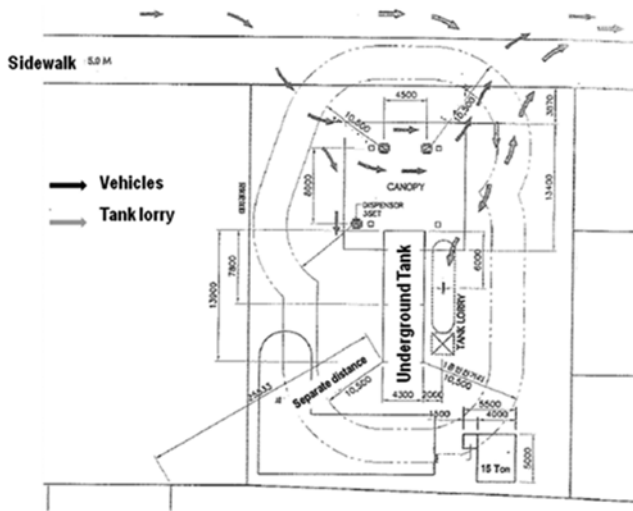
**Fig. 1. Layout of LPG station.**

Table 2 and Fig. 1, as the described by Melchers and Feutrill [8] and Park et al. [9]. Every facility at an LPG filling station must keep a distance of at least 10.5 m apart from the border of the station for safety in Korea, which is quite similar to that of Australia by Melchers and Feutrill. [8] This distance is defined as safety distance in regulation related to LPG station. LPG composition is assumed for butane, which is used in Korea in the most cases. The compressor connected to the vapor line of 25A (25 mm diameter) compresses vapor butane from underground storage tanks to pressurize tank lorries. Then the butane in the tank lorry is unloaded to an underground tank via liquid line of 50A (50 mm diameter). Vehicle is filled via 50A liquid line from underground tank with outlet pressure of 8.0 kg/cm<sup>2</sup>.

## LAYER OF PROTECTION ANALYSIS

### 1. Estimating Consequences and Severity

#### 1-1. Release Rate

Major sources of release at LPG filling station include, but are not restricted to, pipelines, gasket/flanges, and dispense hoses by Melchers and Feutrill [8]. In this work, three equivalent diameters of a hole are assumed according to the type of release source. The smallest one, 12.5 mm, is considered having a diameter equivalent to the leak from slightly loosened flange or corroded gasket (Case

**Table 3. Mass flow of LPG (butane) for the Case A, B, and C at liquid phase and vapor phase release**

Equivalent diameter of release (mm)	Release rate (kg/s)	
	Liquid phase	Vapor phase
12.5 (Case 1)	2.28	0.21
25 (Case 2)	9.12	0.85
50 (Case 3)	36.57	-*

\*The LPG station has no 50 mm diameter line for vapor phase

1). The next one, 25 mm, is an equivalent diameter to the release from heavily loosened flange or corroded gasket of 50A pipeline or rupture of 25A pipeline (Case 2). An equivalent diameter of 50 mm is assumed for rupture of 50A pipeline or disconnection of unloading liquid line (Case 3). Melchers and Feutrill suggested the relative probabilities of the above three cases are 0.85, 0.10, and 0.05, respectively [8].

By assuming liquid phase release from loading hose of dispenser, underground inlet pipeline, or under liquid level of tank lorry, the mass flow rate  $Q_m$  resulting from a hole of equivalent area  $A$  is given by Eq. (1) [10].

$$Q_m = AC_0 \sqrt{2\rho g_c P_g} \quad (1)$$

where  $C_0$  denotes the discharge coefficient and a complicated function of the Reynolds number of the fluid escaping through the release and the diameter of the hole and taken as 0.61 [11]. With outlet pressure of liquid pump, 8 kg/cm<sup>2</sup>, the calculated the release rates for each case are given in Table 3.

LPG vapor release takes place through vapor return line, gas compressor, or above liquid level of tank lorry. The vapor release velocity through a hole is sonic since the storage pressure is greater than twice of atmospheric pressure. The mass flow rate  $Q_m$  resulting from a hole of equivalent area  $A$  is given by Eq. (2) [12].

$$Q_m = C_0 A P_0 \sqrt{\frac{\gamma g_c M}{Z R_g T_0} \left(\frac{2}{\gamma+1}\right)^{(\gamma+1)/(\gamma-1)}} \quad (2)$$

where  $M=58$  kg/kmol,  $Z=0.984$  and  $\gamma=C_p/C_v=1.1176$  at 15 °C, and the constant term  $\sqrt{\gamma \left(\frac{2}{\gamma+1}\right)^{(\gamma+1)/(\gamma-1)}}$  is estimated to be 0.632 for butane.

The mass flow rates of Case 1, 2, and 3 are summarized in Table 3.

1-2. Jet Fire  
Jet fire can occur by an immediate ignition of released vapor, and has a huge momentum. The flame is treated as a multiple source radiator and the impingement distance and the heat radiated from the source is expressed simply by the following [13].

$$L_i = 6\sqrt{Q_m} \quad (0 < Q_m (\text{kg/s}) < 50) \quad (3)$$

$$q_x = \frac{F_r (-\Delta H_c) Q_m \tau}{4\pi x^2} \quad (4)$$

$$\tau = 1 - 0.0565 \ln x \quad (5)$$

Although the fraction of heat radiation  $F_r$  is a function of heat

**Table 4. Heat flux from a jet flame at the specific distance of 21 m**

Equivalent diameter of release (mm)	Release rate $Q_m$ (kg/s)	Flame length $L_f$ (m)	Heat flux $q_x$ (kW/m <sup>2</sup> )
12.5 (Case 1)	0.21	2.75	1.09
25 (Case 2)	0.85	5.53	2.18

released, 0.13 is taken conservatively. The transmissivity factor  $\tau$  is expressed as a function of distance simply [10]. The heat flux at the specific distance of 21 m, which is equivalent to twice of safety distance defined by the law and located in residential area, can be calculated by Eqs. (3)-(5) as summarized in Table 4.

### 1-3. Pool Fire

Release of liquid phase LPG and the formation of liquid pool with release duration can be expressed by equation as [14]

$$A(t) = \frac{Q_m}{v_r} \left( 1 - e^{-\frac{v_r t}{\rho \cdot z}} \right) \quad (6)$$


In case of ignition, the pool fire may occur and the area can be described as Eq. (7).

$$A_f(t) = \frac{Q_m}{b_r} - \left( \frac{Q_m}{b_r} - A_0 \right) e^{-\frac{v_r t}{\rho \cdot z}} \quad (7)$$

The diameter of the pool fire for each case is given in Fig. 2, showing maximum values. Although wind has effect on the consequence area by tilting the flame, it is not easy to calculate the area case by case. In this work, only a simple case without wind is calculated. In case of small release with 12.5 mm equivalent diameter, with 25 mm equivalent diameter, and with 50 mm equivalent diameter, the maximum radii of flame are estimated to be 2.6 m, 5.3 m, and 10.5 m, respectively.

The heat generated by pool fire and the corresponding heat flux can be approximated as [13]

$$q = b_r(-\Delta H)A \quad (8)$$

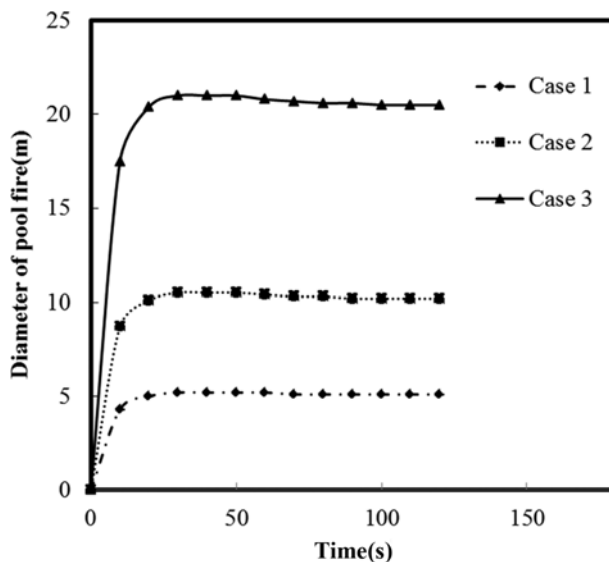**Fig. 2. Size of LPG pool with time.****Table 5. Heat flux from a pool fire at the specific distance of 21 m**

Equivalent diameter of release (mm)	Release rate $Q_m$ (kg/s)	Maximum diameter $D$ (m)	Heat flux $q_x$ (kW/m <sup>2</sup> )
12.5 (Case 1)	2.28	5.2	15.1
25 (Case 2)	9.12	10.5	41.6
50 (Case 3)	36.57	21.0	140.9

$$q_x = \tau q / 4\pi x^2 \quad (9)$$

The heat flux for three cases is predicted for a specific distance of 21 m, which is equivalent to the twice of separation distance by regulation as shown in Table 5.

### 1-4. Boiling Liquid Expanding Vapor Explosion (BLEVE)

LPG in tank lorry might be heated by nearby jet fire or pool fire to cause a BLEVE [9,17]. The major damage caused by BLEVE of LPG tank because of the radiative heat of a fireball can be analyzed by the following equations [17]:

$$t_{BLEVE} = 0.852 M_{fireball}^{0.26} \quad (10)$$

$$D_{max} = 6.48 M_{fireball}^{0.333} \quad (11)$$

$$H_{BLEVE} = 0.75 D_{max} \quad (12)$$

$$q_x = \frac{F_r M_{fireball} (-\Delta H_C)}{\pi D_{max}^2 t_{BLEVE}} \quad (13)$$


The BLEVE can take place only in a tank lorry since underground tanks cannot be heated enough to initiate BLEVE. During unloading from a tank lorry to underground tank or dispensing to vehicles, liquid phase LPG may be released from a disconnected coupler or a damaged pipeline to form an LPG pool, and a pool fire might develop in the presence of an ignition source. In that case, the nearby tank lorry is under a pool fire risk. When external fire heats the tank lorry, a safety relief valve is activated and vapor releases through the valve forming a jet fire before explosion [9]. The typical capacity of a butane tank lorry is 13 tons, and 3 ton release was assumed during heating the tank lorry before BLEVE and 10 tons take part in BLEVE. The maximum diameter of the fireball is then estimated to be 129 meters having 97 meter height and 9.0 second duration time [9]. By Eqs. (10)-(13), heat flux at 21 m can be predicted as 421 kW/m<sup>2</sup>.

### 1-5. Summary of Consequence and Severity

The heat flux and corresponding damage of jet fire, pool fire, and BLEVE are summarized in Table 6. The jet fire has rather slight level of consequence, as shown in the table. The pool fire has heavier level of consequence than jet fire corresponding to high level of damage, so that even at small-scale release of liquid, the operator cannot perform his or her duty and must be sheltered by equipment. With a medium scale release, the pool fire has enough energy to cause damage to the process equipment. With a large-scale release, the pool fire can become so hazardous that 100% fatality at the distance of 21 m is estimated in about 10 seconds' exposure. For BLEVE, the hazard of a fire ball becomes extremely high so that immediate exposure may cause a fatality.

**Table 6. Heat flux from fire hazards at the specific distance of 21 meters**

Fire hazard	Equivalent diameter of release (mm)	Release rate $Q_m$ (kg/s)	Heat flux $q_x$ (kW/m <sup>2</sup> )	Corresponding damage (LOPA textbook)	Hazard level (LOPA textbook)
Jet fire	12.5 (Vapor line) Case 1	0.21	1.38	No discomfort for long exposure (Minor or no injury)	Low (Low consequence)
	25 (Vapor line) Case 2	0.85	2.77	Time to pain threshold in 30-40 seconds (Single injury, not severe)	Medium (Medium consequence)
Pool fire	12.5 (Liquid line) Case 1	2.28	15.1	Operators are not likely to perform duty (One or more severe injury)	High (High consequence)
	25 (Liquid line) Case 2	9.12	41.6	Sufficient to cause damage to equipment (One or more severe injury)	High (High consequence)
	50 (Liquid line) Case 3	48.57	187.1	100% fatality about 10 seconds exposure (Fatality or permanently disabling injury)	Very high (Very high consequence)
BLEVE	-	-	421	100% fatality less than 3 seconds exposure (Fatality or permanently disabling injury)	Extremely high (Very high consequence)

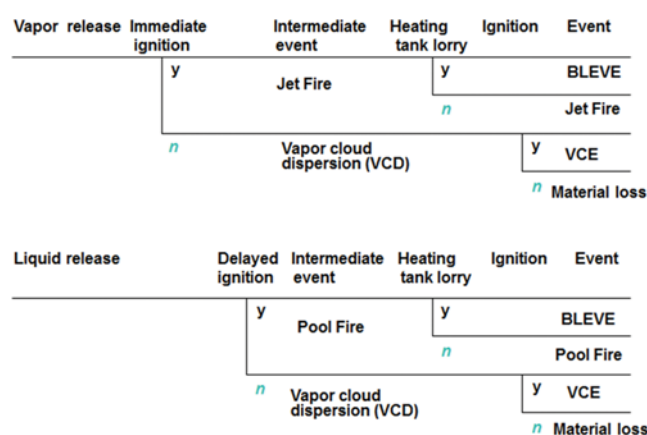**Fig. 3. Event tree analysis on fire hazard of LPG filling station.**

## 2. Developing Scenarios

Event tree analysis (ETA) on the fire hazard of LPG filling station has been conducted as shown in Fig. 3. We can have jet fire if gas releases from the gas pipeline with immediate ignition. More specifically, a jet fire is assumed by an immediate ignition of vapor released from loosened gasket of a vapor line, corroded vapor line, or rupture of vapor line. These are described further in scenarios S1-S3. Pool fire may occur if LPG releases in liquid pipeline to make a pool and is then ignited. More specifically, a pool fire is assumed by an immediate ignition of a liquid pool formed by release from loosened gasket of liquid line, corroded liquid line, rupture of liquid line, ruptured unloading arm by tank lorry start during unloading, or unloading arm by misconnection during unloading. They are described in scenarios S4-S10. BLEVE is assumed in the case that the jet fire or the pool fire heats the vapor part of the tank lorry parked near the fire. Initiation events are LPG release from a loosened gasket, from a pipeline failure, or from a tank lorry or vehicle starting during unloading or dispensing. Ignition is the enabling event of the jet fire and the pool fire while heating nearby tank lorry is the enabling event of the BLEVE.

### 2-1. Jet Fire

S1: Failure of gasket at vapor line (initiating event)→small scale release with equivalent diameter of 12.5 mm→ignition (enabling event)→jet fire

S2: Failure of vapor line (initiating event)→small scale release with equivalent diameter of 12.5 mm→ignition (enabling event)→jet fire

S3: Rupture of 25A vapor line (initiating event)→medium scale release with equivalent diameter of 25 mm→ignition (enabling event)→jet fire

### 2-2. Pool Fire

S4: Failure of gasket at liquid line (initiating event)→small-scale release with equivalent diameter of 12.5 mm→ignition (enabling event)→pool fire

S5: Failure of liquid line (initiating event)→small-scale release with equivalent diameter of 12.5 mm→ignition (enabling event)→pool fire

S6: Failure of gasket at liquid line (initiating event)→medium scale release with equivalent diameter of 25 mm→ignition (enabling event)→pool fire

S7: Failure of liquid line (initiating event)→medium scale release with equivalent diameter of 25 mm→ignition (enabling event)→pool fire

S8: Rupture of liquid line (initiating event)→large-scale release with equivalent diameter of 50 mm→ignition (enabling event)→pool fire

S9: Leak in the tank lorry transfer line during unloading→large-scale release with equivalent diameter of 50 mm→ignition (enabling event)→pool fire

S10: Improper coupling of hose during unloading→large-scale release with equivalent diameter of 50 mm→ignition (enabling event)→pool fire

### 2-3. BLEVE

S11: Dispenser hose rupture by vehicle start with dispenser hose connected→failure in quick detection and action→ignition→fire around dispenser→heating tank lorry by the fire nearby dispenser (enabling event)→hot spot→BLEVE

**Table 7. Scenario development for the fire and the explosion hazards**

Scenario number	Initiating event	Event (Equivalent diameter of release)	Enabling event	Consequence
S1	Loosening gasket at vapor line	Small scale release (12.5 mm)		
S2	Failure of vapor line	Small scale release (12.5 mm)	Ignition	Jet fire
S3	Rupture of vapor line	Medium scale release (25 mm)		
S4	Loosened gasket	Small scale release (12.5 mm)		
S5	Failure at liquid line			
S6	Loosened gasket	Medium scale release (25 mm)	Ignition of pool	Pool fire
S7	Failure at liquid line			
S8	Rupture of liquid line	Large scale release (50 mm)		
S9	Leak in tank lorry transfer line during unloading			
S10	Improper coupling of hose during unloading			
S11	Dispenser hose rupture	Medium scale release (25 mm)		
S12	Dispenser flange leak	Small scale release (12.5 mm)		
S13	Disconnection during unloading	Large scale release (50 mm)	Heating nearby tank lorry	BLEVE
S14	Tank lorry start during unloading	Large scale release (50 mm)		
S15	Loading arm flange leak	Small scale release (12.5 mm)		
S16	Loading arm rupture	Large scale release (50 mm)		

S12: Dispenser flange leak→failure in quick detection and action→ignition→fire around dispenser→heating tank lorry by the fire nearby dispenser (enabling event)→hot spot→BLEVE

S13: Disconnection during unloading by bad connection of coupler by human error→failure in quick detection and action→ignition→fire around loading arm→heating tank lorry by the fire nearby loading arm (enabling event)→hot spot→BLEVE

S14: Tank lorry start during unloading→failure in quick detection and action→ignition→fire around loading arm→heating tank lorry by the fire nearby loading arm (enabling event)→hot spot→BLEVE

S15: Loading arm flange leak→failure in quick detection and action→ignition→fire around loading arm→heating tank lorry by the fire nearby loading arm (enabling event)→hot spot→BLEVE

S16: Loading arm rupture→failure in quick detection and action→ignition→fire around loading arm→heating tank lorry by the fire nearby loading arm (enabling event)→hot spot→BLEVE

The above scenarios are summarized in Table 7.

### 3. Identifying Independent Protection Layers (IPLs) and Determining the Frequency of Scenarios

#### 3-1. Identifying IPLs

An independent protection layer (IPL) is defined by a device, system, or action that can prevent a scenario from proceeding to its undesired consequence as described in the LOPA textbook. The safeguards are candidate IPLs and can be categorized as process design, basic process control system (BPCS), critical alarm and human intervention, safety instrumented function (SIF), physical protection, post-release protection, plant emergency response, and/or community emergency response. In this work, the IPLs for jet fire are vapor line emergency shutdown valve (ESV), fire extin-

guisher, and gas detector. The IPLs for pool fire are liquid line ESV, fire extinguisher, and gas detector. The IPLs for BLEVE are liquid line shut down valve, liquid line ESV, fire extinguisher, gas detector, and fuse metal safety valve of tank lorry.

#### 3-2. Determining the Frequency of Scenarios

For each scenario, frequency is estimated by Eq. (14)

$$f_i^C = f_i^I \times \prod_{j=1}^J \text{PFD}_{ij} \quad (14)$$

For a jet fire, the frequency is calculated by the S1-S3 as follows.

$$f_i^{\text{jet}} = f_i^I \times \left( \prod_{j=1}^J \text{PFD}_{ij} \right) \times P^{\text{ignition}} \quad (15)$$

The frequencies of occurrences of jet fires are calculated by Eq. (15) with the PFDs given in Table 8. With vapor line gasket (PFD=1.0×10<sup>-2</sup>), vapor line emergency shutdown valve (PFD=3.5×10<sup>-2</sup>), fire extinguisher (PFD=0.04), gas detector (PFD=1.8×10<sup>-1</sup>), and the probability of an immediate ignition of 0.296, the frequency of the small scale jet fire by the gasket failure is estimated by Eq. (15) as  $f_1^{\text{jet}}=7.5 \times 10^{-7}$ . Likewise, the frequency of the small-scale jet fire by the pipeline failure and can be approximated as  $f_2^{\text{jet}}=7.5 \times 10^{-8}$ . The frequency of the small-scale jet fire is the summation of  $f_1^{\text{jet}}$  and  $f_2^{\text{jet}}$ , which is  $8.3 \times 10^{-7}$ . The medium scale jet fire is also found as  $f_3^{\text{jet}}=7.5 \times 10^{-10}$ .

The frequencies for a pool fire are also calculated for scenarios S4-S10.

$$f_i^{\text{pool}} = f_i^I \times \left( \prod_{j=1}^J \text{PFD}_{ij} \right) \times P^{\text{ignition}} \quad (16)$$

Table 8. Frequency of each event

	Event	Likelihood	Reference
A	Bad connection of coupler by human error	$1.0 \times 10^{-5}$ /connection	19
B	ESV failure	$3.5 \times 10^{-2}$ /y	21
C	Failure in early stage extinguish by extinguisher	0.04	19
D	Failure in early stage recognition	0.1	20
E	Failure in screening fire by firewall	$1.0 \times 10^{-2}$	21
F	Failure in shutdown valve for excess flow	$1.0 \times 10^{-2}$	20
G	Failure in water deluge system	0.1	21
H	Frequency of unloading	490/y	19
I	Gas detector failure	$1.8 \times 10^{-1}$ /y	21
J	Gasket failure	$1 \times 10^{-2}$ /y	15
K	Heating vapor part of tank lorry	$3.0 \times 10^{-2}$	19
L	Leak at dispenser flange	$1.8 \times 10^{-3}$ /y	21
M	Leak at loading arm flange	$1.2 \times 10^{-3}$ /y	21
N	Manual valve failure	$4.4 \times 10^{-3}$ /y	20
O	Piping leak	$1 \times 10^{-3}$ /y	15
P	Probability of immediate ignition	0.296	21
Q	Probability of tank lorry heating by fire nearby dispenser	0.03	21
R	Probability of tank lorry heating by fire nearby loading arm	0.7	21
S	Quick coupler failure	$1.0 \times 10^{-4}$	20
T	Rupture of loading arm	$3.5 \times 10^{-4}$ /y	20
U	Tank lorry fuse cock failure	$3.5 \times 10^{-2}$ /y	15
V	Tank lorry start during unloading	0.33/y	20
W	Tank lorry start during unloading or Vehicle star during dispensing	3/y	19

The frequencies of each scenario can be estimated by Eq. (16) for PFDs of liquid pipeline failure and liquid line emergency shutdown valve (ESV) failure.

$$f_4^{pool} = 7.5 \times 10^{-7}, f_5^{pool} = 7.5 \times 10^{-8}, f_6^{pool} = 7.5 \times 10^{-7}, f_7^{pool} = 7.5 \times 10^{-8}, \\ f_8^{pool} = 7.5 \times 10^{-10}, f_9^{pool} = 9.0 \times 10^{-7}, f_{10}^{pool} = 3.7 \times 10^{-8}$$

Thus, the frequency of small scale pool fire is the summation of S4 and S5,  $8.3 \times 10^{-7}$ , medium scale pool fire is the summation of S6 and S7,  $3.3 \times 10^{-3}$ , and large scale pool fire is the summation of S8, S9, and S10,  $9.4 \times 10^{-7}$ .

For a BLEVE, the frequency is calculated by the S11-S16 as fol-

lows.

$$f_i^{BLEVE} = f_i \times \left( \prod_{j=1}^J \text{PFD}_j \right) \times P^{heating} \quad (17)$$

A BLEVE will occur if we have a jet fire or a pool fire and it heats the vapor part of tank lorry for a while. With the IPLs given the above scenarios S1-S10, an additional IPL is installed like the fuse metal safety valve of a tank lorry. The frequency of failure in early stage detection and action comes from either failure in manual valve shutdown or failure in emergency valve shutdown, and can be calculated by the FTA illustrated as in Fig. 4.

$$f_{failure}^{DI+N} = (DI+N) + (DI+B) = [(1.8 \times 10^{-1})(0.1) + 4.4 \times 10^{-3}] \\ + [(1.8 \times 10^{-1})(0.1) + 3.5 \times 10^{-2}] = 7.54 \times 10^{-2}$$

The frequency of S11-S16 can be estimated by Eq. (17), additionally assuming the probability of vapor phase heating is 0.1 [19].

$$f_{11}^{BLEVE} = (SW)(f_{failure}^{DI+N})(P)(CQ)(K) \\ = (3 \times 0.0001)(7.54 \times 10^{-2})(0.296)(0.04 \times 0.03)(0.1) \\ = 8.03 \times 10^{-10}$$

$$f_{12}^{BLEVE} = (L)(f_{failure}^{DI+N})(P)(CQ)(K) \\ = (1.8 \times 10^{-3})(7.54 \times 10^{-2})(0.296)(0.04 \times 0.03)(0.1) \\ = 4.82 \times 10^{-9}$$

$$f_{13}^{BLEVE} = (AH)(f_{failure}^{DI+N})(P)(UCR)(K) \\ = (1.0 \times 10^{-5} \times 490)(7.54 \times 10^{-2})(0.296)(3.5 \times 10^{-2})(0.04 \times 0.7)(0.1) \\ = 1.07 \times 10^{-8}$$

$$f_{14}^{BLEVE} = (V)(f_{failure}^{DI+N})(P)(UCR)(K)$$

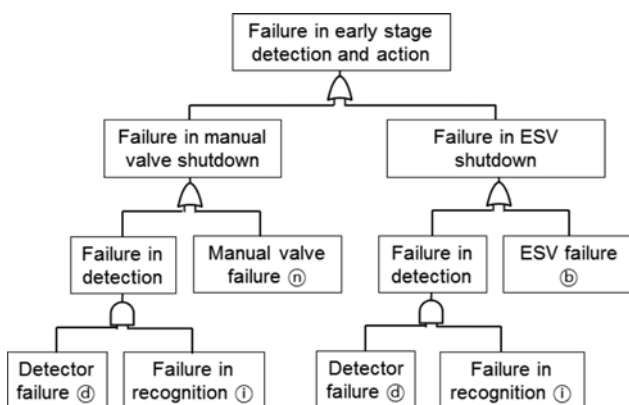


Fig. 4. Fault tree analysis to valuate failure in early stage detection and action.

**Table 9. Risk matrix corresponding to jet fire, pool fire, and BLEVE of an LPG station (Conventional)**

Frequency per year	Consequence			
	Low consequence	Medium consequence	High consequence	Very high consequence
10 <sup>-7</sup>	S1 (Small jet fire)		S4, S5 (Small pool fire)	S9 (Large pool fire) S14 (BLEVE)
10 <sup>-8</sup>	S2 (Small jet fire)		S6, S7 (Medium pool fire)	S10 (Large pool fire) S13 (BLEVE)
10 <sup>-9</sup>				S12, S15 (BLEVE)
10 <sup>-10</sup>		S3 (Medium jet fire)		S8 (Large pool fire) S11, S16 (BLEVE)

$$= (0.33)(7.54 \times 10^{-2})(0.296)(3.5 \times 10^{-2})(0.04 \times 0.7)(0.1)$$

$$= 7.22 \times 10^{-7}$$

$$f_{15}^{BLEVE} = (M)(f_{failure}^{jet})(P)(UCR)(K)$$

$$= (1.2 \times 10^{-3})(7.54 \times 10^{-2})(0.296)(3.5 \times 10^{-2})(0.04 \times 0.7)(0.1)$$

$$= 2.62 \times 10^{-9}$$

$$f_{16}^{BLEVE} = (T)(f_{failure}^{jet})(P)(UCR)(K)$$

$$= (3.5 \times 10^{-4})(7.54 \times 10^{-2})(0.296)(3.5 \times 10^{-2})(0.04 \times 0.7)(0.1)$$

$$= 7.67 \times 10^{-10}$$

The frequency of BLEVE is the summation of the above six scenarios and gives.

**4. Risk Reducing Measures**

Risk matrix was listed according to the severity and frequency of outcomes and described in Table 9. Since the hazards associated with jet fires are low or medium with frequencies about 10<sup>-7</sup>-10<sup>-8</sup>, the risk is small enough not to require any further safety measures. As shown in the table, the hazard associated with large-scale pool fire and BLEVE is very high. An effective way to reduce the likelihood of large amount of liquid release is to install an excess flow shutdown valve for dispenser to block unexpected sudden flow increasing. With this new IPL with the probability of failure on demand (PFD) of 0.01, [19] the frequencies of the large pool fires reduced to by the following equation:

$$f_{large, new}^{pool} = (f_8^{pool} + f_9^{pool} + f_{10}^{pool}) \times PFD^{excess\ valve} = 9.4 \times 10^{-9}$$

Three safeguards are suggested to reduce the risk associated with fire hazards additionally. Considering the effectiveness, independence, and auditability, two kinds of post-release protection and

one critical alarm have been recommended. As a post-release protection, a firewall between tank lorry parking area and LPG facility is recommended, which will reduce the likelihood of exposure of tank lorry to the fire in dispensing area. AEA report showed that the PFD of a firewall is 0.01. A water deluge system for tank lorry is known to be another effective measure for post-release protection to prevent hot spot at a tank exposed to fire, with the PFD of 0.03 [21]. An additional gas detector installed around loading arm reduced the likelihood of failure in early stage detection by 0.18 [21].

The risk associated with BLEVE can be reduced further if an excess flow shutdown valve for a dispenser is installed or an additional firewall between the tank lorry parking area and storage facility is constructed. Also, an appropriate water deluge system for tank lorry considerably reduces the risk of pool fire or BLEVE. The likelihood of BLEVE for the improved system is estimated by the following equation:

$$f_{new}^{BLEVE} = \left[ (f_{11}^{BLEVE} + f_{12}^{BLEVE})(PFD^{excess\ valve} \times PFD^{firewall}) + (f_{13}^{BLEVE} + f_{14}^{BLEVE} + f_{15}^{BLEVE} + f_{16}^{BLEVE}) \times PFD^{detector} \right] \times PFD^{water\ deluge} = 3.98 \times 10^{-10}$$

**CONCLUSIONS**

Layer of protection analysis (LOPA) was conducted on the fire hazard of LPG filling station. Three equivalent hole-areas of release were assumed to estimate consequence and corresponding severity. For the liquid phase, the release rate of each case was estimated, while

**Table 10. Risk matrix corresponding to jet fire, pool fire, and BLEVE of an LPG station (Improved)**

Frequency per year	Consequence			
	Low consequence	Medium consequence	High consequence	Very high consequence
10 <sup>-7</sup>				
10 <sup>-8</sup>				
10 <sup>-9</sup>			S4, S5 (Small pool fire)	Sum of all large pool fire
10 <sup>-10</sup>	S1 (Small jet fire)		S6, S7 (Medium pool fire)	Sum of all BLEVE
10 <sup>-11</sup>	S2 (Small jet fire)			
10 <sup>-12</sup>		S3 (Medium jet fire)		

only two cases were considered for vapor phase release since an LPG station does not have any 50A vapor line. At the same diameter, liquid phase release rate was much more than vapor phase as shown in Table 3.

The hazards of the jet fire, the pool fire, and the BLEVE were studied and categorized in five levels and compared with the corresponding categories given in the LOPA textbook [7], as summarized in Table 6. For the jet fire, low and medium level of consequence was estimated. For the pool fire, high and very high level hazards were estimated, while extremely high hazards were obtained for the BLEVE.

Scenarios were developed for the jet fire, the pool fire, and the BLEVE. For each scenario, independent protection layer (IPL) was identified and its frequency was estimated.

Risk matrix was prepared with consequence and frequency of each scenario. As shown in Table 9, large-scale pool fire and BLEVE have high risk. Four additional IPLs were considered, such as a firewall between tank lorry parking area and LPG facility, water deluge system for tank lorry, gas detector around loading arm, and excess flow valve for liquid pipeline to stop unexpected sudden flow increasing. By adding IPL of excess flow valve for liquid pipeline, the frequency of large-scale pool fire reduced remarkably. Addition of a firewall between tank lorry parking area and LPG facility, gas detector around loading arm, or water deluge system for tank lorry also reduces the frequency of BLEVE low enough. The results of the improved system are summarized in Table 10.

#### ACKNOWLEDGEMENT

The author would like to acknowledge and thank the support of the Energy Technology Development Program of Korea Government with item number of 20132010500050.

#### NOMENCLATURE

A : equivalent area of release [ $m^2$ ]  
 $A_0$  : area of LPG pool before ignition [ $m^2$ ]  
 $A(t)$  : area of LPG pool at time t [ $m^2$ ]  
 $A_f(t)$  : area of LPG pool flame at time t [ $m^2$ ]  
 $C_0$  : discharge coefficient (0.61)  
 $D_{max}$  : maximum diameter of LPG participating BLEVE [m]  
 $-\Delta H_C$  : heat of combustion [kJ/kg mol]  
 $F_r$  : fraction of heat radiation (0.1284 for jet fire and pool fire, 0.4 for BLEVE)  
 $H_{BLEVE}$  : height of BLEVE [m]  
 $L_i$  : length of jet flame impingement [m]  
 $M$  : molecular weight of the escaping vapor or gas [kg/kg mol]  
 $M_{fireball}$  : mass of LPG participating BLEVE [kg]  
 $P_0$  : process pressure [atm/ $m^3$ ]  
 $P_g$  : gauge pressure [atm/ $m^3$ ]  
 $P_{heating}^{heating}$  : probability of heating vapor part of tank lorry  
 $P_{ignition}^{ignition}$  : probability of ignition  
 $PFD^{excess\ valve}$  : probability of failure on demand of excess flow valve for dispenser  
 $PFD^{firewall}$  : probability of failure on demand of firewall between LPG facility and tank lorry parking area

$PFD^{water\ curtain}$  : probability of failure on demand of water deluge system for tank lorry  
 $Q_m$  : mass flow rate [kg/s]  
 $R_g$  : ideal gas constant [ $0.082057\ m^3\ atm/kg\ mol\ K$ ]  
 $T_0$  : temperature of the source [K]  
 $Z$  : compressibility factor  
 $b_r$  : combustion rate of LPG [ $0.099\ kg/m^2\ s$ ]  
 $f_i^C$  : frequency of scenario  
 $g_c$  : gravitational constant [ $1\ (kg\ m/s^2)/N$ ]  
 $q$  : heat flux [ $kW/m^2$ ]  
 $q_x$  : heat flux at distance x m [ $kW/m^2$ ]  
 $t_{BLEVE}$  : time of BLEVE duration [s]  
 $v_r$  : vaporization rate of LPG [ $0.03\ kg/m^2\ s$ ]  
 $x$  : distance from radiation [m]  
 $z$  : pool depth [m]  
 $\gamma$  : ratio of the heat capacity ( $=C_p/C_v$ )  
 $\rho$  : density of fluid [ $kg/m^3$ ]  
 $\tau$  : atmospheric transmissivity

#### REFERENCES

1. Korea Ministry of Environment, *Development of implementation measures on off-site consequence assessment*, Government Report, 11-1480000-001311-01 (2014).
2. Korea Ministry of Environment, *Development of implementation measures of Korean risk management plan*, Government Report, 11-1480802-000007-01 (2014).
3. Korea Gas Safety Corp., Statistics on high pressure gas, 72 (2014).
4. S. Jung, *Korean J. Chem. Eng.*, **33**(1), 1 (2016).
5. R. Singh, H. J. Lee, A. K. Singh and D. P. Kim, *Korean J. Chem. Eng.*, **33**(8), 2253 (2016).
6. S. Tong, Z. Z. Wu, R. J. Wang and Y. Q. Duo, *Korean J. Chem. Eng.*, **33**(8), 2291 (2016).
7. CCPS, *Layer of protection analysis: Simplified process risk assessment*, New York, 71 (2001).
8. R. E. Melchers and W. R. Feutrill, *J. Reliability Eng. Sys. Safety*, **74**, 283 (2001).
9. K. Park, S. M. Mannan, Y.-D. Jo, J.-Y. Kim, N. Keren and Y. Wang, *J. Hazard. Mater.*, **137**(1), 62 (2006).
10. D. A. Crowl and J. F. Louvar, *Chemical process safety: Fundamentals with applications*, Prentice-Hall, New Jersey, 2<sup>nd</sup> Ed., 114 (2001).
11. F. P. Lees, *Loss prevention in the process industries: Hazard identification, assessment and control*, Elsevier Butterworth-Heinemann, 3<sup>rd</sup> Ed., 15/7 (2005).
12. D. A. Crowl and J. F. Louvar, *Chemical process safety: Fundamentals with applications*, Prentice-Hall, New Jersey, 2<sup>nd</sup> Ed., 133 (2001).
13. F. P. Lees, *Loss prevention in the process industries: Hazard identification, assessment and control*, Elsevier Butterworth-Heinemann, 3<sup>rd</sup> Ed., 16/214 (2005).
14. CCPS, *Guideline for chemical process quantitative risk analysis*, 2<sup>nd</sup> Ed., New York, 224 (2000).
15. CCPS, *Guideline for chemical process quantitative risk analysis*, 2<sup>nd</sup> Ed., New York, 268 (2000).
16. F. P. Lees, *Loss prevention in the process industries: Hazard identification, assessment and control*, Elsevier Butterworth-Heinemann, 3<sup>rd</sup> Ed., 16/188 (2005).



17. CCPS, *Guideline for chemical process quantitative risk analysis*, 2<sup>nd</sup> Ed., New York, 204 (2000).
18. D. A. Crowl and J. F. Louvar, *Chemical process safety: Fundamentals with applications*, Prentice-Hall, New Jersey, 2<sup>nd</sup> Ed., 504 (2001).
19. Korea Gas Safety Corp., LPG Station Risk Assessment Report (2003).
20. CCPS, *Guidelines for process equipment reliability data - with data tables*, New York, 33 (1989).
21. AEA/CS/HSE R1403, *BLEVE probability of an LPG road tanker during unloading* (1995).